



PDHonline Course C227 (2 PDH)

Indoor Mold and Moisture Basics

Instructor: John Huang, Ph.D., PE and John Poullain, PE

2020

PDH Online | PDH Center

5272 Meadow Estates Drive
Fairfax, VA 22030-6658
Phone: 703-988-0088
www.PDHonline.com

An Approved Continuing Education Provider

Appendix C: Moisture, Mold and Mildew


Molds and mildew are fungi that grow on the surfaces of objects, within pores, and in deteriorated materials. They can cause discoloration and odor problems, deteriorate building materials, and lead to allergic reactions in susceptible individuals, as well as other health problems.

The following conditions are necessary for mold growth to occur on surfaces:

- n temperature range above 40°F and below 100°F
- n mold spores
- n nutrient base (most surfaces contain nutrients)
- n moisture

Human comfort constraints limit the use of temperature control. Spores are almost always present in outdoor and indoor air, and almost all commonly used construction materials and furnishings can provide nutrients to support mold growth. Dirt on surfaces provides additional nutrients. Cleaning and disinfecting with non-polluting cleaners and antimicrobial agents provides protection against mold growth. Other sections of this document have discussed the importance of building maintenance and proper sanitation in preventing IAQ problems. However, it is virtually impossible to eliminate all nutrients. Moisture control is thus an important strategy for reducing mold growth.

Mold growth does not require the presence of standing water; it can occur when high relative humidity or the hygroscopic properties (the tendency to absorb and retain moisture) of building surfaces allow sufficient moisture to accumulate. Relative humidity and the

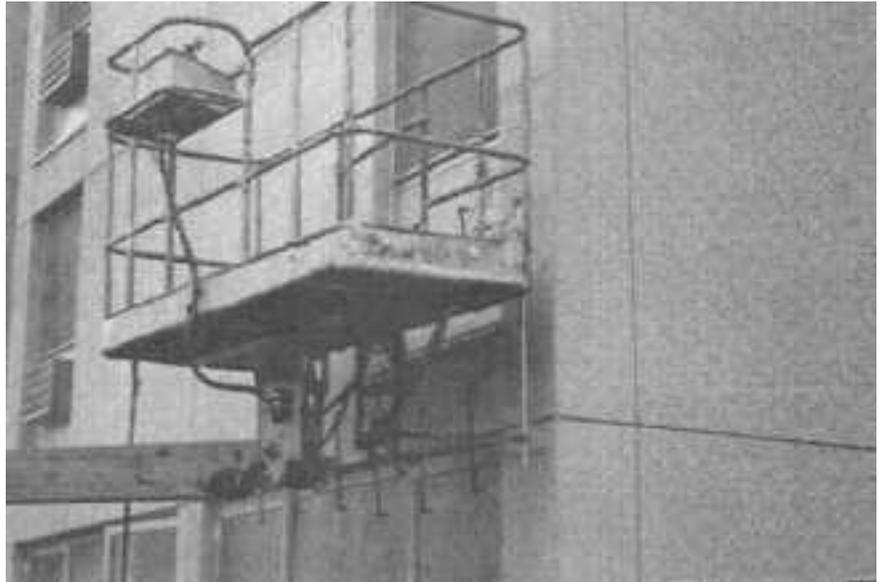


factors that govern it are often misunderstood. This appendix is intended to give building managers an understanding of the factors that govern relative humidity, and to describe common moisture problems and their solutions.

BACKGROUND ON RELATIVE HUMIDITY, VAPOR PRESSURE, AND CONDENSATION

Water enters buildings both as a liquid and as a gas (water vapor). Water, in its liquid form, is introduced intentionally in bathrooms, kitchens, and laundries and accidentally by way of leaks and spills. Some of that water evaporates and joins the water vapor that is exhaled by building occupants as they breathe or that is introduced by humidifiers. Water vapor also moves in and out of the building as part of the air that is mechanically introduced or that infiltrates and exfiltrates through openings in the building shell. A

There were complaints of visible water damage and musty odors in this senior citizen housing complex. Investigators confirmed that the problem was rain entry by using an array of hoses to spray the walls with water, while operating the building under negative pressure. The test showed that rain was entering at the joints of the exterior cladding, rather than at cracks around windows.

FIGURE C-1: Moisture Gain in a Building

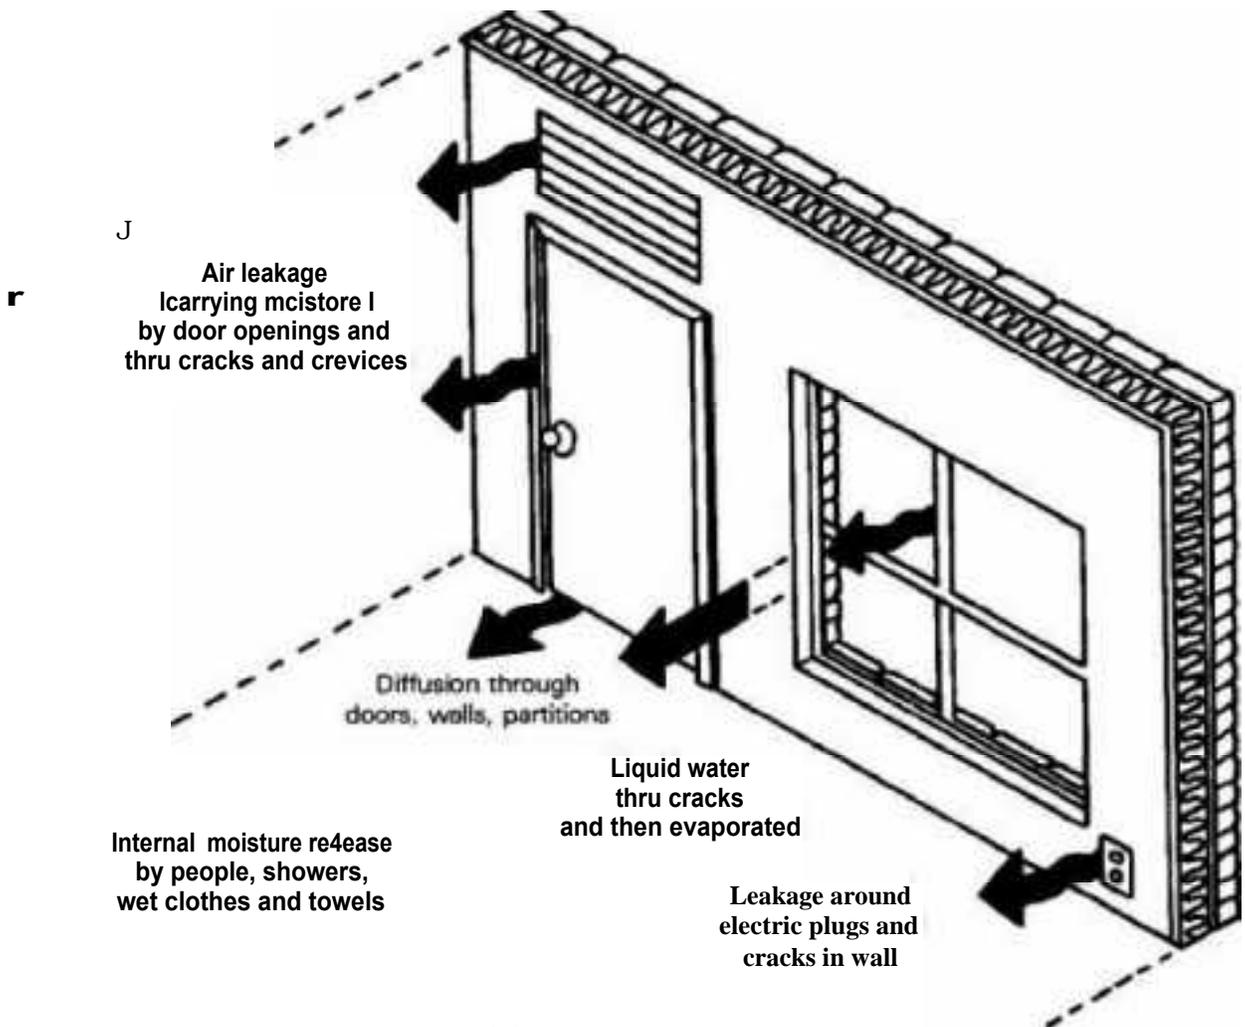

$$\text{Moisture Gain} = \text{Leakage} + \text{Diffusion} - \text{Internal}$$

Courtesy of Dean Wallace Shakun, Clayton State College, Morrow, GA

lesser amount of water vapor diffuses into and out of the building through the building materials themselves. Figure C-1 illustrates locations of moisture entry.

The ability of air to hold water vapor decreases as the air temperature is lowered. If a unit of air contains half of the water vapor it can hold, it is said to be at 50% relative humidity (RH). As the air cools, the relative humidity increases. If the air contains all of the water vapor it can hold, it is at 100% RH, and the water vapor condenses, changing from a gas to a liquid. It is possible to reach 100% RH without


changing the amount of water vapor in the air (its "vapor pressure" or "absolute humidity"); All that is required is for the air temperature to drop to the "dew point."

Relative humidity and temperature often vary within a room, while the absolute humidity in the room air can usually be assumed to be uniform. Therefore, if one side of the room is warm and the other side cool, the cool side of the room has a higher RH than the warm side.

The highest RH in a room is always next to the coldest surface. This is referred as the "first condensing surface," as it will

FIGURE C-2: Relationship of Temperature, Relative Humidity, and Moisture in the Air

A relative *humidity* reading taken in a room will *only give an accurate* indication of the actual amount of moisture present if a *temperature* reading is taken at the same time. The chart below shows that air at 70°F and 40% RH contains approximately 0.006 pounds of moisture per pound of dry air (as indicated by the bold line), while air that is at 50°F and 40% RH contains approximately 0.003 pounds of moisture per pound of dry air (as indicated by the dashed line). Although both are *at 40% RH*, the 70°F *air* contains roughly *twice* as much moisture as the 50°F air.

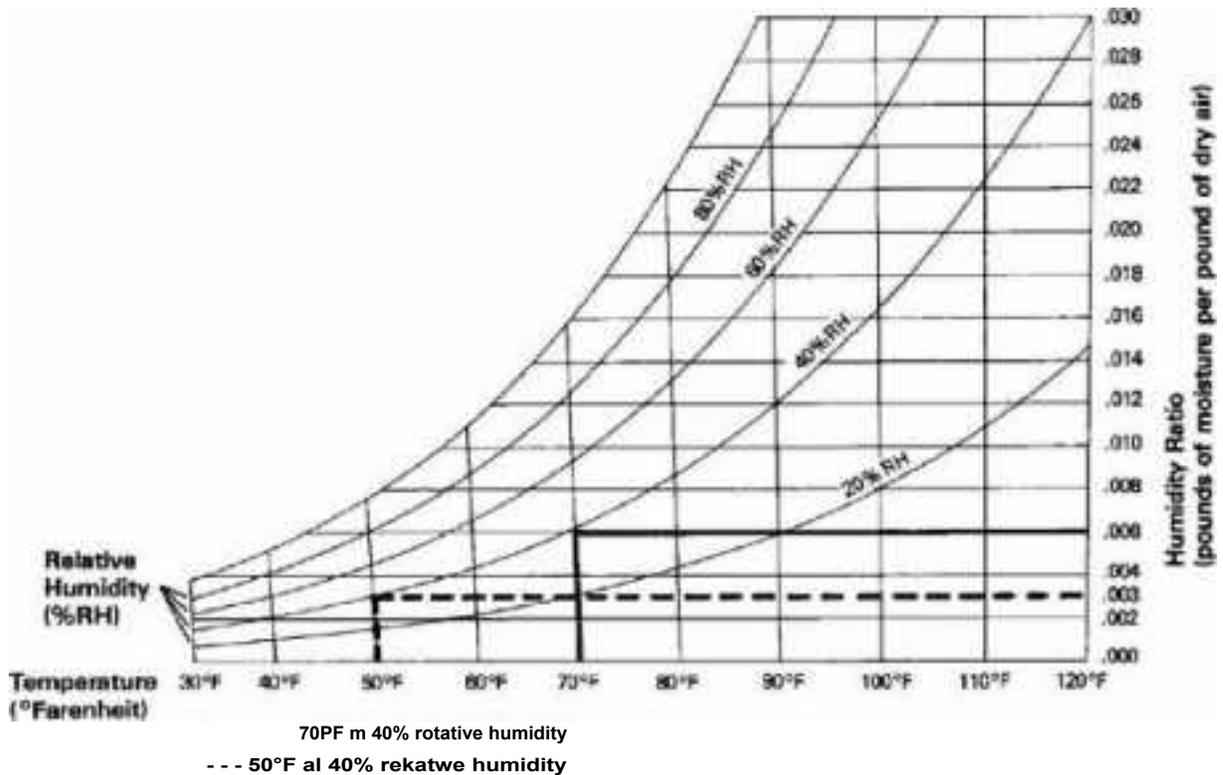

SOURCE: Adapted from Psychrometric Chart from ASHRAE Fundamentals, 1981

be the location where condensation first occurs, if the relative humidity at the surface reaches 100%. It is important to understand this when trying to understand why mold is growing on one patch of wall or only along the wall-ceiling joint. It is likely that the surface of the wall is cooler than the room air because there is a void in the insulation or because wind is blowing through cracks in the exterior of the building.

TAKING STEPS TO REDUCE MOISTURE

Mold and mildew growth can be reduced where relative humidities near surfaces can be maintained below the dew point. This can be accomplished by reducing the moisture content (vapor pressure) of the air, increasing air movement at the surface, or increasing the air temperature (either the general space temperature or the temperature at building surfaces).